




COORDENADAS.		PERFURAÇÃO(m)		
UTM		Ø	De	Até
X	=9198622.00	14"3/4	0.00	96,00
Y	=462702.00	-	-	-
Z	=	-	-	-
BP =0.80 m		-	-	-
FILTROS(m)		COMPLETAÇÃO(pol)		
Ø	Quant. (m)	Ø	De	Até
8"	40,00	8"	0.00	95,50
		-	-	-
		-	-	-
		-	-	-
Total= 40,00				
EQUIPAMENTO INSTALADO				
Bomba HAUPT, submersível, mod. P84-4				

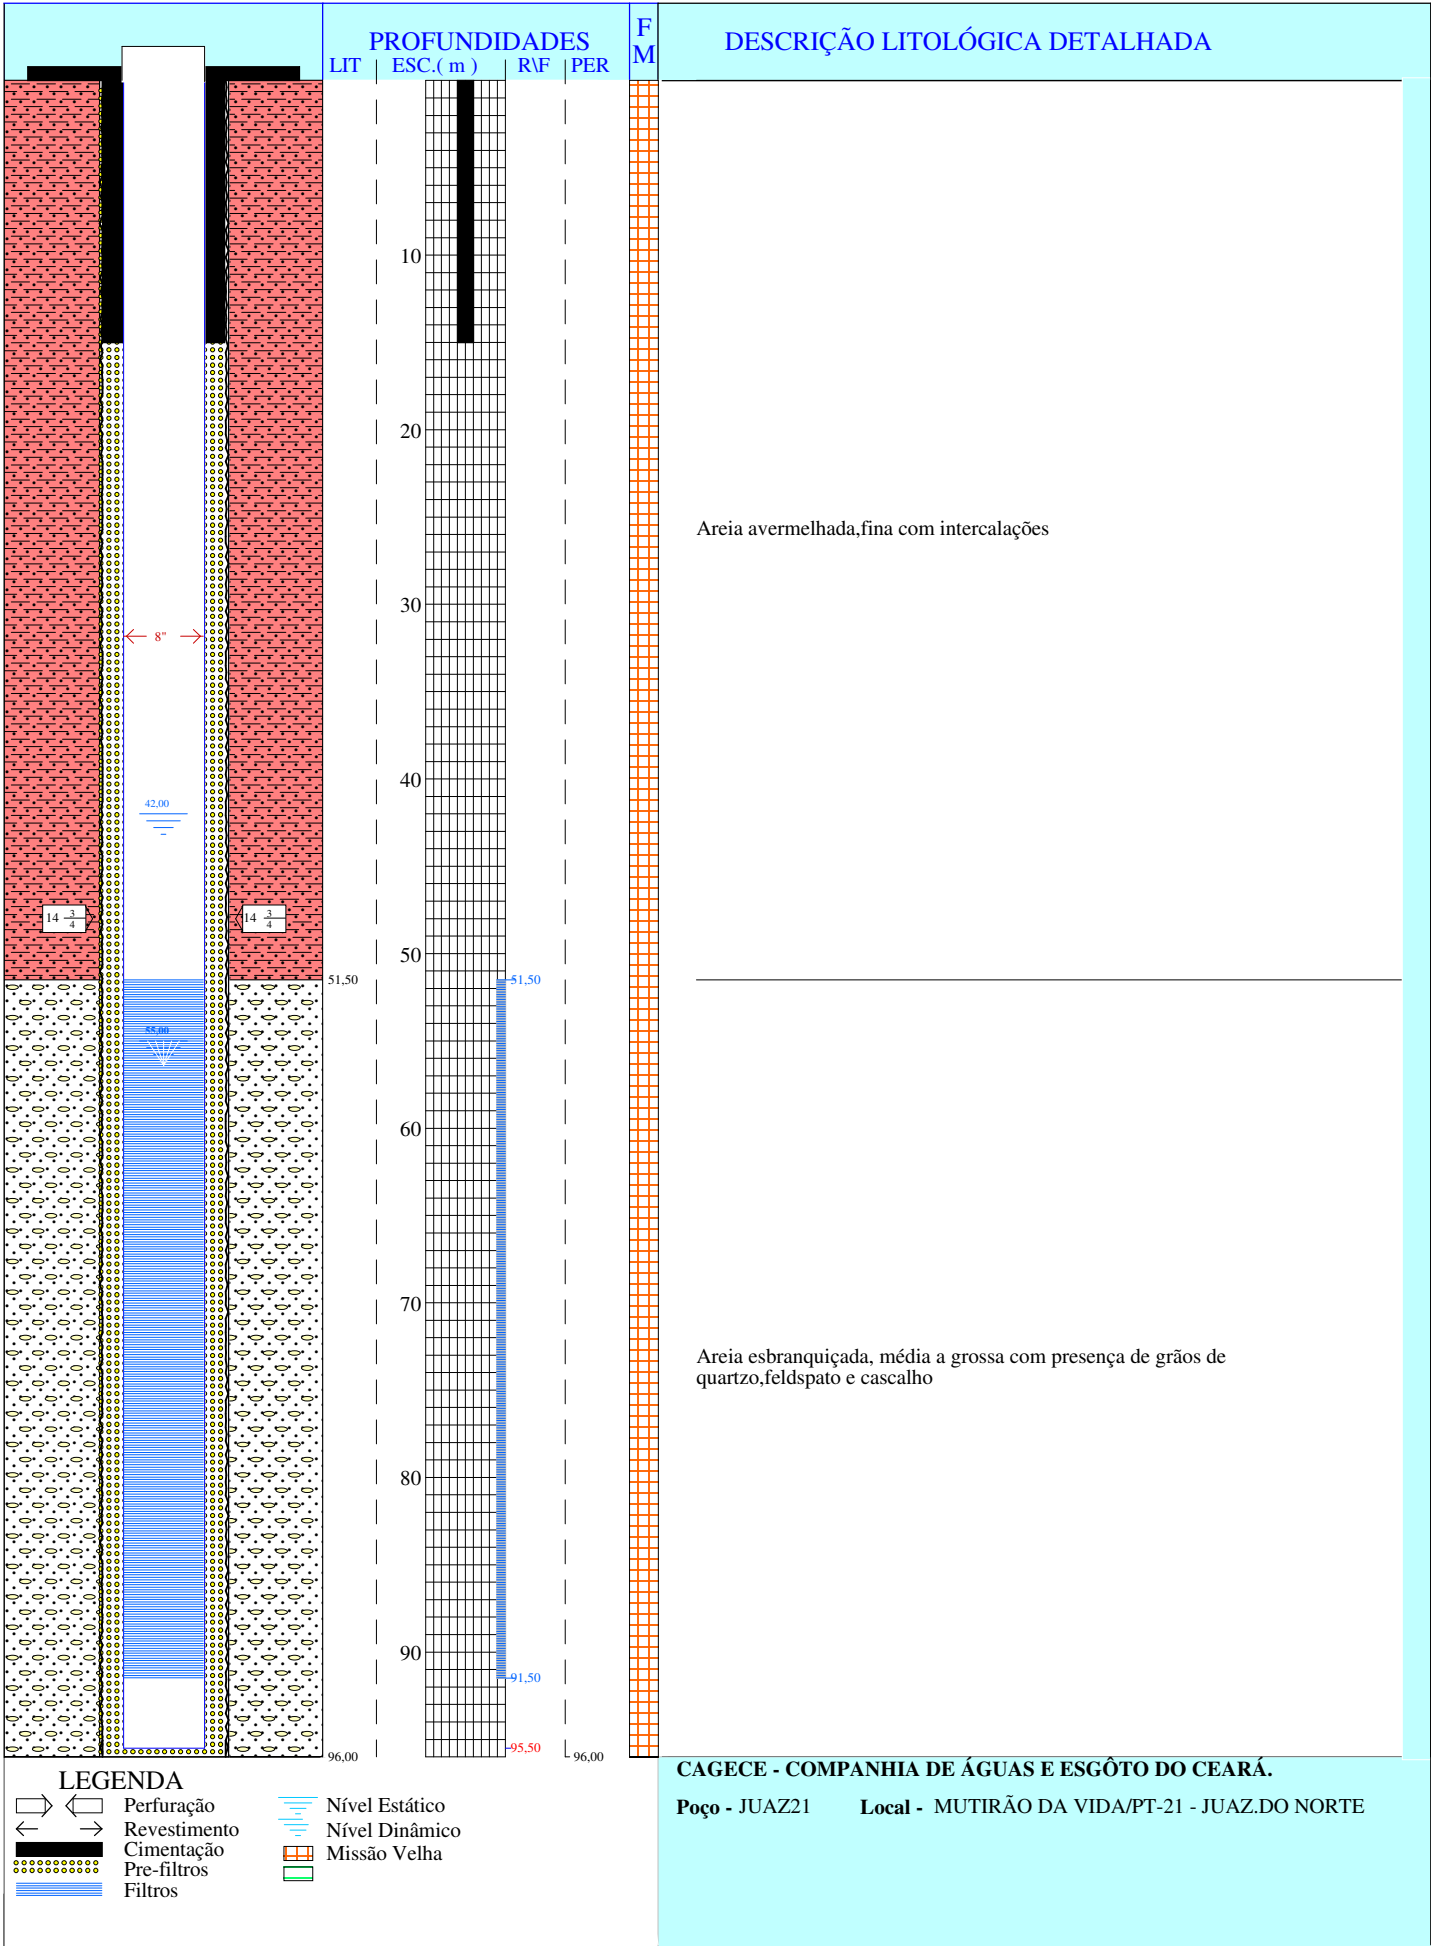

[illegible]